

TEST REPORT

The Intertek logo consists of the word "Intertek" in white, sans-serif font, centered within a dark blue rounded rectangle.

REPORT NUMBER: 100604363TOR-004c

ISSUE DATE: March 27, 2012

EVALUATION CENTER

Intertek Testing Services NA Ltd.
6225 Kenway Drive
Mississauga, ON L5T 2L3

RENDERED TO
Titan Building Products
71-5450 Canotek Road
Ottawa, Ontario K1J 9G6

PRODUCT EVALUATED:
6x6 Primus post anchors (6' spacing)

EVALUATION PROPERTY:
Load Tests on Guards

Report of load testing for Titan Building Products of a guard rail system utilizing 6x6 Primus post anchors spaced 1.83 m (6') apart for compliance with the applicable requirements of 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units."

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

1 Table of Contents

1	Table of Contents	2
2	Introduction.....	3
3	Test Sample	3
3.1.	Sample and Assembly Description.....	3
3.2.	Drawings	4
4	Test and Evaluation Methods.....	5
4.1.	SPECIMEN PREPARATION	5
4.2.	CONDITIONING	5
4.3.	TEST PROCEDURES	5
4.3.1	Tributary Load Requirements - Horizontal Concentrated Load on Post	6
4.3.2	Horizontal Concentrated Load on Post.....	6
4.3.3	Horizontal Concentrated Load at Top Rail at Midspan.....	7
4.3.4	Horizontal Uniform Load at Top Rail	7
4.3.5	Horizontal Load on Balusters.....	8
4.3.6	Vertical Uniform Load on Top Rail.....	8
5	Test and Evaluation Results	9
5.1.	Tributary Load Results - Horizontal Concentrated Load on Post.....	9
5.2.	Horizontal Concentrated Load on Post.....	9
5.3.	Horizontal Concentrated Load at Top Rail at Midspan.....	10
5.4.	Horizontal Uniform Load at Top Rail	10
5.5.	Horizontal Load on Balusters.....	11
5.6.	Vertical Uniform Load on Top Rail.....	11
6	Test Equipment.....	11
7	Conclusion	12
8	Appendix A – Drawings	13
9	Appendix B – Revision Page.....	16

2 Introduction

This test report covers load tests performed on a guard (rail) system utilizing 6x6 Primus post anchors spaced 1.83 m (6') apart anchored to an SPF (spruce, pine, fir) substrate. Based on the guard rail construction as noted in this report, it serves to qualify the 6x6 Primus post anchor as a method of securement to the SPF substrate.

The test loads applied were as set forth in the following:

- 2006 Ontario Building Code (OBC) Section 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.
- 2010 National Building Code of Canada (NBC), Section 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.

In addition, factored loads (based on the appropriate resistance factors) were applied to the load specifications. This evaluation began on February 27, 2012 and was completed on February 28, 2012.

3 Test Sample

The 6x6 Primus post anchors were submitted by the client on July 21, 2011.

Load testing (horizontal and vertical, concentrated and uniform) was conducted on a guard rail system assembled with 6x6 Primus post anchors spaced 2.13 m (7') apart on centre.

In addition, load testing on a single post utilizing a 6x6 Primus post anchor was conducted to determine tributary load requirements and appropriate post spacing.

It is deemed by Intertek that the load requirements for a guard rail system with 6x6 Primus post anchors spaced 2.13 m (7') apart on centre will satisfy load requirements for any guard rail system with a lesser post anchor spacing.

3.1. Sample and Assembly Description

This system represents a rail system that has the following characteristics:

- Centre-to-centre post spacing is no longer than 1.829 m (6')
- The guard rail system described is qualified for an infinite run of railing

3.1. Sample and Assembly Description (continued..)

Top Rail and Hand Rail:

The top rail length measured 1689 mm (66-1/2"). A plastic mount was fastened to each end of the top rail using two #8x2-1/2" screws. Each mount was subsequently fastened to the post with three #8x2-1/2" screws.

In addition, for the balusters, fifteen 13/16" diameter holes were drilled into the bottom side of the top rail, spaced 114 mm (4-1/2") apart on centre, 1 inch deep.

The hand rail measured 1689 mm (66-1/2") in length and was fastened to either side to the 6x6 post with three #10x3-1/2" flat-head screws "toenailed" from the top of the handrail into the post. The hand rail was also fastened onto the top rail with five #10x3-1/2" screws, equally spaced approximately 13" apart. The top of the hand rail was 1070 mm (42-1/8") from the floor.

Bottom Rail

The bottom rail length measured 1689 mm (66-1/2"). A plastic mount was fastened to each end of the bottom rail using two #8x2-1/2" screws. Each mount was subsequently fastened to the post with three #8x2-1/2" screws.

In addition, for the balusters, fifteen 13/16" diameter holes were drilled into the top side of the bottom rail, spaced 114 mm (4-1/2") apart, 1 inch deep.

Posts

Each post was assembled with a 6x6 Primus post anchor. Each post anchor was assembled to the post as per the packaging instructions. Each pressure-treated SPF post measured 140 mm by 140 mm by 1016 mm (5.5" x 5.5" by 40") long.

6x6 SPF lumber was cut to 1016 mm (40") lengths. A 1-3/4" diameter hole saw was used to cut a circular pilot cut identical to the diameter of the tube in the centre of the 6x6 post about 42-48 mm (1-5/8" to 1-7/8") deep. The inner wood core of the cut remained and the sharp edge of the tube was aligned and set into the pilot cut at a vertical attitude and driven with force into the solid core of the post until the base of the anchor was flush against the post bottom. Four pilot holes measuring 1/4" diameter were drilled a minimum of 50 mm (2") deep into the post. Then, six 3/8"x5" lags screws fastened the anchor to the post.

Each post was fastened into an SPF base that measured 76 mm (3") thick (fastened perpendicular to the wood grain) with eight #14x3" screws.

Balusters

Each rail section was outfitted with fifteen balusters each measuring 19 mm (3/4") diameter and 940 mm (37") in length. Each baluster was capped with a small plastic cover that was inserted into the top and bottom rail sections.

3.2. Drawings

Post Anchor Drawing: Titan Post Anchor System – Titan 6X6 04, dated Mar 10, 09.
(2 pages)

4 Test and Evaluation Methods

4.1. SPECIMEN PREPARATION

The post anchor specimens were shipped to the Intertek laboratory in Mississauga, Ontario. The guard system was assembled by the client.

4.2. CONDITIONING

The guard specimens were tested in the laboratory under ambient conditions. No specific conditioning parameters were required before testing. After purchase, the SPF wood was allowed to be accustomed to the test environment for a minimum of two weeks.

4.3. TEST PROCEDURES

Since the guard system was symmetrical, it is Intertek's professional opinion that the loads applied from one side would achieve results that are equal to loads applied to the other side.

A single post consisting of a 6x6 SPF post and a 6x6 Primus post anchor anchored to an SPF substrate was tested for concentrated horizontal load in order to establish a centre-to-centre post spacing.

A guard rail system utilizing 6x6 Primus post anchors spaced 2.13 m (7') apart was also tested for other required loads. The following tests were conducted on the guard rail system utilizing 6x6 Primus post anchors:

- concentrated horizontal load on balusters (to qualify the requirement for elements within the guard). This was evaluated only for its effect on the post anchor.
- distributed vertical load at top rail (to qualify the requirement for a guard system with 1.83 m (6') post spacing.
- concentrated horizontal load at top rail at midspan (to qualify the requirement for a guard system with 1.83 m (6') post spacing.
- distributed horizontal load at top rail (to qualify the requirement for a guard system with 1.83 m (6') post spacing.

The test loads applied were as set forth in the following:

- 2006 Ontario Building Code Section 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.
- 2010 National Building Code of Canada Section 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.

Appropriate factored loads were applied to the load specifications. Due to the limited number of samples, the guard rail was tested at a higher safety factor than what was required based on calculations from Limit States Design (section 4.1.3. of the 2006 OBC and 2010 NBC) and Resistance Factors listed in CSA S16-09, "*Design of steel structures*", Section 13.1 and CSA O86-09, "*Engineering design in wood*".

4.3.1 Tributary Load Requirements - Horizontal Concentrated Load on Post

The tributary load requirement of the guard rail system is based on the assembly information in Section 3 qualifying a centre-to-centre post spacing of 1.83 m (6 ft. 0 in.). An end post anchored in SPF was tested to ultimate failure to determine a mode of failure and subsequently an appropriate material resistance factor (and a combined factor of safety).

4.3.2 Horizontal Concentrated Load on Post

The post was tested for horizontal concentrated load applied at the top rail for a guard rail system anchored in SPF. The tributary load results on the posts as reported in Section 5.1 serve to qualify the guard rail system in SPF.

Basic Load (2006 OBC and 2010 NBC)

The initial position of the top of the post was measured. A concentrated load of 1.0 kN (delivered with a 100 mm by 100 mm platen) was applied at the top of the post by means of a calibrated load cell/single ram/pump system and held for 1 minute. The position of the post was measured. The load was then released and the residual position of the post was again measured.

1.67 Factored Load

A test load of 1.67 kN (factored load of 1.67) was applied to the top of the post rail and the post movement was measured at full load and after removal of the test load. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

4.3.3 Horizontal Concentrated Load at Top Rail at Midspan

Basic Load (2006 OBC and 2010 NBC)

The initial position of the top rail (at mid span) was measured. A concentrated horizontal load of 1.0 kN (delivered with a 100 mm by 100 mm platen) was applied to mid span of the top rail by means of a calibrated load cell/single ram/pump system and held for 1 minute. The position of the top railing was measured. The load was then released and the residual position of the top rail was again measured.

2.5 Factored Load

A test load of 2.5 kN (factored load of 2.5) was applied to mid span of the top rail and the rail movement was measured at full load and after removal of the test load. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

4.3.4 Horizontal Uniform Load at Top Rail

Basic Load (2006 OBC and 2010 NBC)

Quarter-point loading (deemed by Intertek to be equivalent to uniform loading) was applied to the top rail in a horizontal direction by means of the loading system comprised of a calibrated load cell/single ram/pump system and load distributing steel bar. A test load of 0.50 kN/m was applied to the rail. The initial position of the top of the rail at midspan was measured. A total load of 1.07 kN was applied to the rail and held for 1 minute and then released. The load was based on a rail length of 2.13 m on centre.

2.5 Factored Load

A test load of 2.67 kN (factored load of 2.5) was applied to the guard rail system. The top rail movement was measured at full load and after removal of the test load. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

4.3.5 Horizontal Load on Balusters

Basic Load (2006 OBC and 2010 NBC)

The horizontal load on the balusters was conducted only to evaluate its effect on the post anchor. A concentrated load of 0.5 kN (delivered with a 100 mm by 100 mm platen) was applied to the baluster at top, mid, and bottom height by means of a calibrated load cell/single ram/pump system and held for 1 minute. The load was then released. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

2.5 Factored Load

A test load of 1.25 kN (factored load of 2.5) was applied to the baluster at the aforementioned location. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

4.3.6 Vertical Uniform Load on Top Rail

Basic Load (2006 OBC)

Quarter-point loading (deemed by Intertek to be equivalent to uniform loading) was applied to the top rail in a vertical direction by means of the loading system comprised of a calibrated load cell/single ram/pump system and load distributing steel bar. A test load of 1.5 kN/m was applied to the rail. A total load of 2.75 kN was applied to the rail and held for 1 minute. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component. The load was based on a rail length of 1.83 m on centre.

2.5 Factored Load

A test load of 6.86 kN (factored load of 2.5) was applied to the top rail. After release of the load, the system was evaluated for failure, evidence of disengagement of any component and visible cracks in any component.

5 Test and Evaluation Results

5.1. Tributary Load Results - Horizontal Concentrated Load on Post

Table 1. – Ultimate Failure Mode on Horizontal Concentrated Load on Post anchored to SPF substrate	
Failure Mode at Ultimate Load	Combined Factor of Safety
Yielding of post anchor steel	1.67

Based on the failure mode of the load of the post system (anchored to SPF substrate), a combined resistance factor of 1.67 was calculated based on calculations from Limit States Design (section 4.1.3. of the 2006 OBC and 2010 NBC) and Resistance Factors listed in CSA S16-09, “*Design of steel structures*”, Section 13.1 and CSA O86-09, “*Engineering design in wood*”.

It was determined by the Horizontal Concentrated Load on Post (Section 5.2 below) that for an infinite stretch of railing, the maximum centre-to-centre post anchor spacing is 1.83 m (6'). Since the post-to-post spacing is less than 2.0 m, the requirements for tributary load (Horizontal Concentrated Load on Post) are less than the requirements for the horizontal concentrated load on the post. The results for horizontal concentrated load on the post are reported below.

5.2. Horizontal Concentrated Load on Post

Table 3. - Horizontal Concentrated Load on Post anchored to SPF substrate				
Load		Net Deflection (mm)	Residual Deflection (mm)	Test Result
Basic	1.0 kN (225 lbf)	56	6	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system
Factored 1.67 X	1.67 kN (375 lbf)	147	67	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system

Based on the appropriate resistance factor applied, the post anchor (anchored to SPF substrate) satisfied the requirements specified in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units for Horizontal concentrated load (load on post).

5.3. Horizontal Concentrated Load at Top Rail at Midspan

Table 4. - Horizontal Concentrated Load at Top Rail at Midspan				
Load		Net Deflection (mm)	Residual Deflection (mm)	Test Result
Basic	1.0 kN (225 lbf)	39	1	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system
Factored 2.5 X	2.5 kN (562 lbf)	80	5	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system

Based on the appropriate resistance factor applied, the guard system (anchored to SPF substrate) satisfied the requirements specified in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units for Horizontal concentrated load (load at top rail midspan).

5.4. Horizontal Uniform Load at Top Rail

Table 5. - Horizontal Uniform Load at Top Rail				
Load		Net Deflection (mm)	Residual Deflection (mm)	Test Result
Basic	0.50 kN/m (34.3 lbf/ft)	48	9	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system
Factored 2.5 X	1.25 kN/m (85.7 lbf/ft)	138	67	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system

Based on the resistance factor applied, the guard system (anchored to SPF substrate) satisfied the requirements specified in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units for Horizontal uniform load.

5.5. Horizontal Load on Balusters

Table 6. - Horizontal Load on Balusters		
Load		Test Result
Factored 2.5 X	1.25 kN (281 lbf)	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system

Based on the appropriate resistance factor applied, the guard system (anchored to SPF substrate) satisfied the requirements specified in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units for Horizontal load on the balusters.

5.6. Vertical Uniform Load on Top Rail

Table 7. – Vertical Uniform Load on Top Rail		
Load		Test Result
Factored 2.5 X	3.75 kN/m (257 lbf/ft)	After release of the load there was no evidence of disengagement or visible cracks in any component of the post anchor system

Based on the appropriate resistance factor applied, the guard system (anchored to SPF substrate) satisfied the requirements specified in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units for Vertical uniform load on the top rail.

6 Test Equipment

Description	Inventory Number
24" hydraulic ram	-
Electric Hydraulic Pump	-
Artech Load Cell	280-01-0713 Cal Due Dec 1, 2012
Admet Read Out	280-01-0696 Cal Due Dec 1, 2012
Husky Tape Measure	300-01-0956 Cal Due March 12, 2012
Stop Watch	273 01 0923

7 Conclusion

The subject guard system utilizing 6x6 Primus post anchors spaced 1.83 m (6') apart described herein satisfied the basic and factored horizontal and vertical loads (including tributary loads) as set forth in the 2006 Ontario Building Code and 2010 National Building Code of Canada, Section 9.8.8.2 sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.

The guard rail is qualified for installation of the posts anchored to a SPF wood substrate.

Tested by Claudio Sacilotto and Gabriel Fernandes


INTERTEK TESTING SERVICES NA LTD

Reported by:


Claudio Sacilotto, P.Eng
Senior Project Engineer



Reviewed by:


Vern W. Jones, C.E.T.
Laboratory Technologist

8 Appendix A – Drawings

APPENDIX A


(Drawings – 2 pages)



Technical drawing of a square plate with dimensions and a red line path. The plate is square with a side length of 7.50. The dimensions are as follows:

- Top edge: 7.50 (total width)
- Left edge: 7.50 (total height)
- Right edge: 7.50 (total height)
- Bottom edge: 7.50 (total height)
- Top edge segments: 3.25 (left), 1.50 (center), 1.50 (right), 3.25 (right)
- Right edge segments: 3.25 (top), 1.50 (middle), 1.88 (bottom), 3.25 (bottom)
- Bottom edge segments: 3.25 (left), 1.50 (center), 1.50 (right), 3.25 (right)

A red line path is shown, starting from the top center, going down to the bottom center, and then going left to the left center. A blue arrow points to the bottom center of the plate.

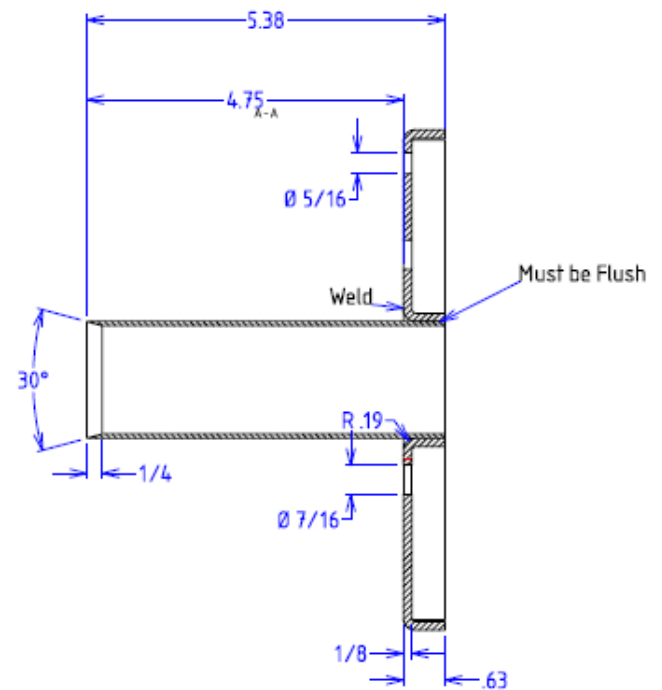

9 Appendix B – Revision Page

Revision No.	Date	Changes	Author	Reviewer
0	March 27, 2012	First issue	Claudio Sacilotto	Vern Jones

END OF DOCUMENT

July 9, 2014

Richard Bergman
Titan Building Products
71-5450 Canotek Road
Ottawa, Ontario K1J 9G6

613.224.9477

rbergman@titanbuildingproducts.com

This letter serves as a response to a request for clarification of the minimum specified loads listed in Article 9.8.8.2 of the 2012 Ontario Building Code.

Intertek has conducted load testing for Titan Building Products on the following:

- Primus 4x4 post anchors anchored to a wood substrate
- Primus 4x4 post anchors (with Chicago Bolt) anchored to a wood substrate
- Primus 6x6 post anchors anchored to a wood substrate

In addition to load testing on the posts, a guardrail system incorporating the posts was also constructed and tested. Details of the post load testing, guardrail construction, test method and test results can be found in the following Intertek Reports:


- 100390597TOR-003a, dated January 30, 2012
- 100390597TOR-003b, dated February 29, 2012
- 100390597TOR-003c, dated February 29, 2012
- 100604363TOR-004b, dated March 27, 2012
- 100604363TOR-004c, dated March 27, 2012

The test loads applied were as set forth in the following:

- 2006 Ontario Building Code Article 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.
- 2010 National Building Code of Canada, Article 9.8.8.2, Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.

On January 1, 2014, the 2012 Ontario Building Code came into effect. Upon review of the 2012 Ontario Building Code it was determined that there were no changes to the minimum specified loads in Article 9.8.8.2, specifically Sentence 1 in conjunction with Table 9.8.8.2 for guards within dwelling units and for exterior guards serving not more than 2 dwelling units.

Please let us know if you have any questions.



Claudio Sacilotto, P. Eng
Senior Project Engineer